


TYPE I – HYDRANT AT END OF WATER MAIN

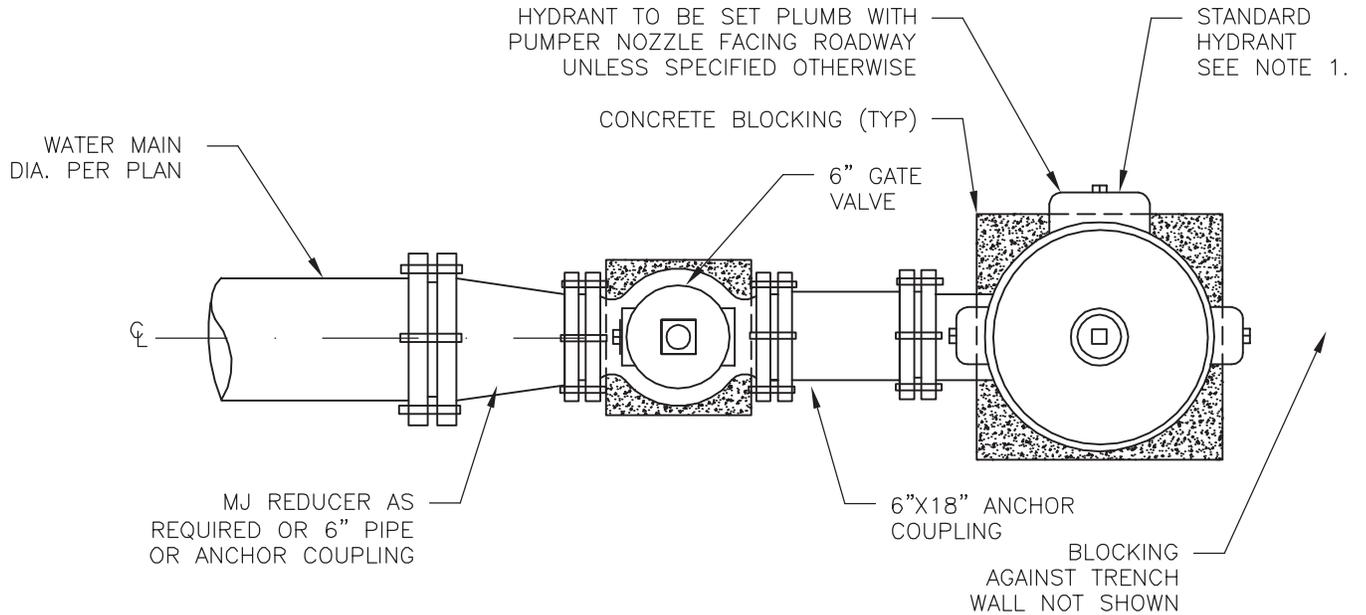

NOTES:

1. PROVIDE MINIMUM OF 4 CU. FT OF 1" TO 2" ROCK OR GRAVEL DRAIN MATERIAL.
2. COVER HYDRANT BARREL, ALL FIXTURES AND CONCRETE BLOCKING WITH POLYETHYLENE SHEETING. LEAVE OPENING FOR DRAINAGE AT BASE OF HYDRANT BARREL.
3. CONCRETE BLOCKINGS SHALL BE PER STANDARD DETAIL 2500-023.
4. SET HYDRANT SO GROUND FLANGE IS 2" TO 6" ABOVE FINISHED GRADE.

FILE NO.: 2500-039	CEDAR RAPIDS METROPOLITAN AREA STANDARD DETAILS FOR PUBLIC IMPROVEMENTS	
APPROVAL DATE: JULY 2010		
REVISION NO.:	HYDRANT SET DETAIL TYPE I – END OF WATER MAIN	NO. 2500-039
REVISION DATE: JULY 2010		