


TYPE III-TS – PARALLEL TO WATER MAIN WITH TAPPING SLEEVE OR SADDLE

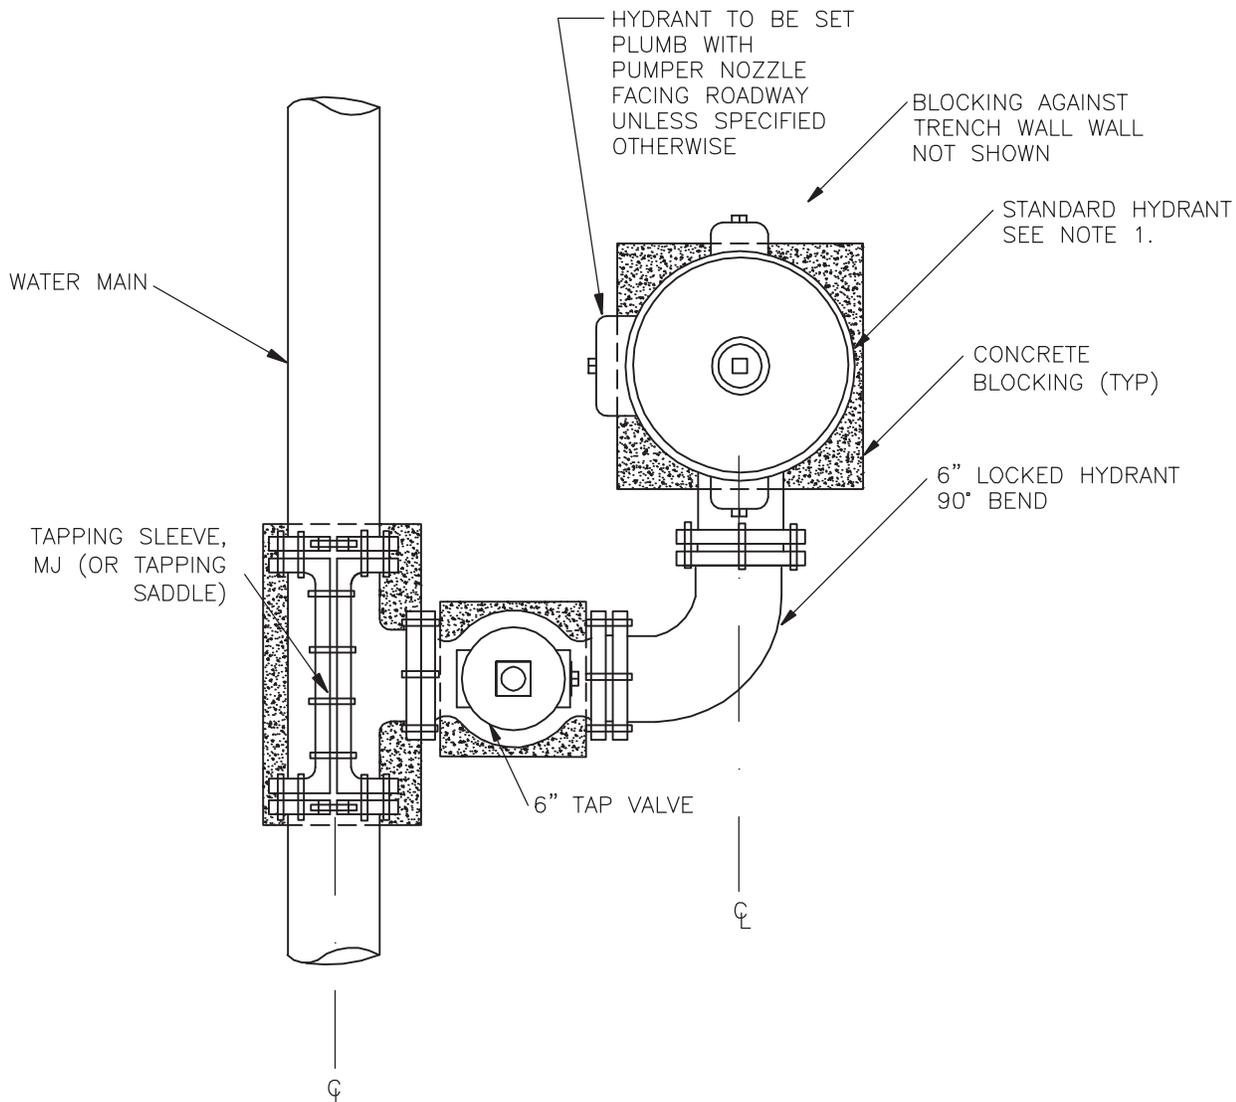

NOTES:

1. PROVIDE MINIMUM OF 4 CU. FT OF 1" TO 2" ROCK OR GRAVEL DRAIN MATERIAL.
2. COVER HYDRANT BARREL, ALL FIXTURES AND CONCRETE BLOCKING WITH POLYETHYLENE SHEETING. LEAVE OPENING FOR DRAINAGE AT BASE OF HYDRANT BARREL.
3. CONCRETE BLOCKING SHALL BE PER STANDARD DETAIL 2500-023.
4. SET HYDRANT SO GROUND FLANGE IS 2" TO 6" ABOVE FINISHED GRADE

FILE NO.: 2500-041
APPROVAL DATE: JULY 2010
REVISION NO.: 1
REVISION DATE: JULY 2010

CEDAR RAPIDS METROPOLITAN AREA STANDARD DETAILS FOR PUBLIC IMPROVEMENTS	
HYDRANT SET DETAIL TYPE III & TYPE III-TS PARALLEL TO WATER MAIN – SHEET 2 OF 2	

NO.
2500-041