



### **ADDENDUM #1**

**To:** All Companies Interested in Submitting a Bid  
**From:** Heather Mell, Purchasing Agent  
**Bid:** Sternberg Decorative Lights (Bid #PUR1016-069); Dated: November 2, 2016  
**Subject:** Addendum #1 (1 page)  
**Date:** November 10, 2016

---

The following questions and/or clarifications were asked relative to the above-listed Request for Bid. This memo is sent for clarification to all companies to whom the bid was sent.

**Question:** What is the mounting orientation and location of the twin head assemblies?

**Answer:**


Item No 1. a drawing is attached as page 2 of this addendum. Light is at 16', handhole is on street side, bolt pattern is parallel with street.

Item No 2. A picture is attached as page 3 of this addendum. Street side light is at 16', backside light is at 10', handhole is on street side, bolt pattern is 45 degrees from parallel with street.

---

All addenda that you receive shall become a part of the contract documents and shall be acknowledged and dated on the bottom of the Signature Page (page 11). The deadline for bid submittal is Thursday, November 17, 2016 at 3:00pm CST.

POLE HEIGHTS HAVE TOLERANCE OF + OR - 2"	DATE	SCALE 3/4" = 1'	DRAWING NUMBER
33RD AVE STREETCAPE	1910LFHW 5516RRT		STERNBERG SINCE 1923
CITY OF CEDAR RAPIDS			

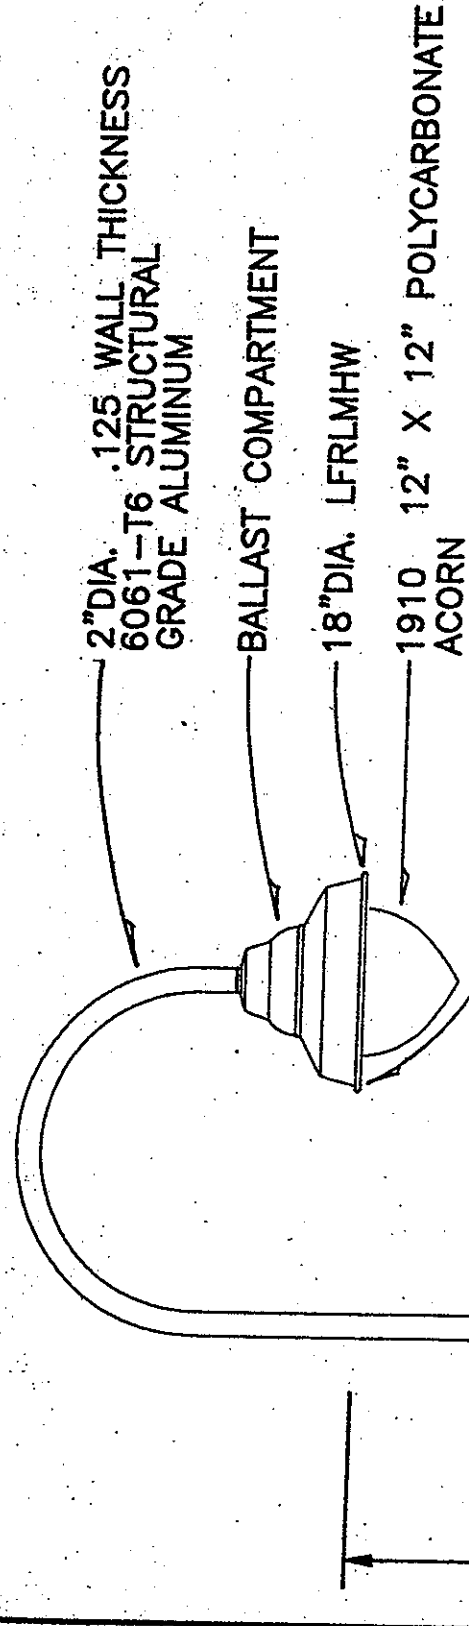

2"DIA. .125 WALL THICKNESS  
6061-T6 STRUCTURAL  
GRADE ALUMINUM

BALLAST COMPARTMENT

18"DIA. LFRLMHW

1910 12" X 12" POLYCARBONATE  
ACORN

UNDERSIDE FINISH IN HIGH  
REFLECTIVITY WHITE ENAMEL

SPRING MOUNTED GLASS  
REFRACTOR TYPE 5

BANNER ARMS SET FOR  
18 X 36" BANNER OVER  
STREET AND SIDEWALK  
SIDES

BANNERS BY OTHERS

SOCKET TYPE	<input checked="" type="checkbox"/> MEDIUM BASE <input type="checkbox"/> MOGUL BASE
VOLTAGE	<input type="checkbox"/> /120 <input type="checkbox"/> /208 <input checked="" type="checkbox"/> /240 <input type="checkbox"/> /277 <input type="checkbox"/> /480 <input type="checkbox"/> /MULTI <input type="checkbox"/> ADVISE <input type="checkbox"/> WIRE TO ?

LIGHT SOURCE AND WATTAGE	<input type="checkbox"/> INCANDESCENT <input type="checkbox"/> 50 MV <input type="checkbox"/> 75 MV <input type="checkbox"/> 100 MV <input type="checkbox"/> 175 MV <input type="checkbox"/> 250 MV <input type="checkbox"/> 50 MH <input type="checkbox"/> 70 MH <input type="checkbox"/> 100 MH <input type="checkbox"/> 150 MH <input type="checkbox"/> 175 MH <input type="checkbox"/> 250 MH <input type="checkbox"/> 35 HPS <input type="checkbox"/> 50 HPS <input type="checkbox"/> 70 HPS <input checked="" type="checkbox"/> 75 HPS HIGH PRESSURE SODIUM <input type="checkbox"/> 100 HPS <input type="checkbox"/> 150 HPS <input type="checkbox"/> 250 HPS <input type="checkbox"/> METAL HALIDE
--------------------------	---

FUSED	<input type="checkbox"/> WITH LAMP
-------	------------------------------------

Advise Finish	<input type="checkbox"/> Swedish Iron <input type="checkbox"/> Verde Green <input type="checkbox"/> Park Green <input type="checkbox"/> Black <input type="checkbox"/> Architectural <input type="checkbox"/> Medium Bronze <input checked="" type="checkbox"/> IOWA MINT RD AC 137 P PLUMBERRY LRVG
---------------	--

5" TO 3" DIA. TAPERED POLE  
6061-T6 STRUCTURAL  
GRADE ALUMINUM.

POLE WELDED FOR SINGLE UNIT  
CONSTRUCTION.

CUSTOM FINISH  
PROVIDE 2" X 2"  
COLOR CHIP TO MATCH

ACCESS DOOR WITH STAINLESS STEEL  
ALLEN HEAD SCREWS

12" DIA. BASE COVER .750 FLOOR THICKNESS  
4 ANCHOR BOLTS.

16'  
13'

